


# ONE HEATER TWO PASS ONE VERTICAL TANK

Domestic Piping D-1  
Rev. 6

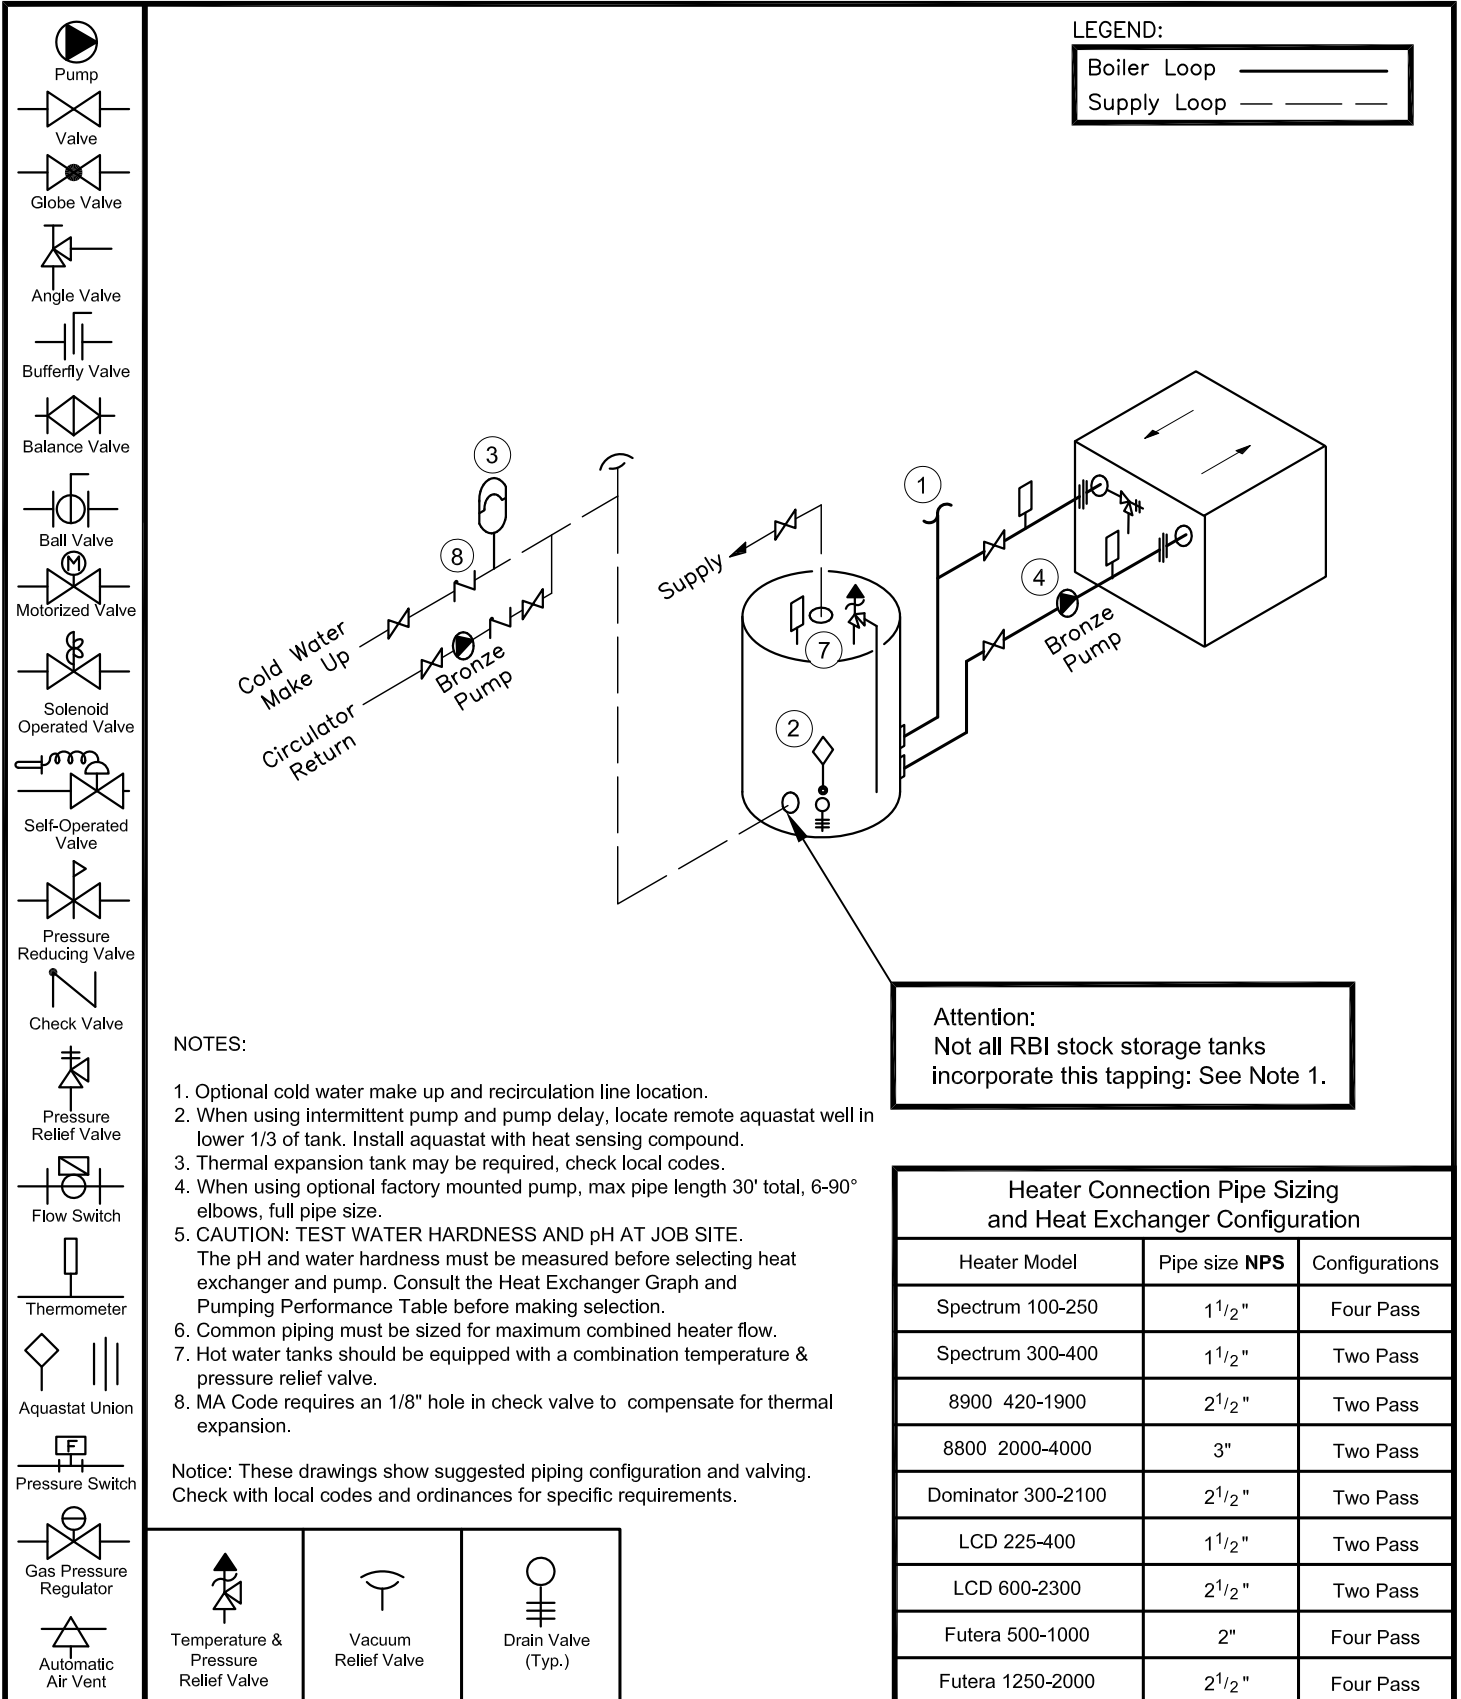

**LEGEND:**

Boiler Loop —————

Supply Loop - - - - -

**Attention:**  
Not all RBI stock storage tanks  
incorporate this tapping: See Note 1.

**NOTES:**

1. Optional cold water make up and recirculation line location.
2. When using intermittent pump and pump delay, locate remote aquastat well in lower 1/3 of tank. Install aquastat with heat sensing compound.
3. Thermal expansion tank may be required, check local codes.
4. When using optional factory mounted pump, max pipe length 30' total, 6-90° elbows, full pipe size.
5. **CAUTION: TEST WATER HARDNESS AND pH AT JOB SITE.**  
The pH and water hardness must be measured before selecting heat exchanger and pump. Consult the Heat Exchanger Graph and Pumping Performance Table before making selection.
6. Common piping must be sized for maximum combined heater flow.
7. Hot water tanks should be equipped with a combination temperature & pressure relief valve.
8. MA Code requires an 1/8" hole in check valve to compensate for thermal expansion.

Notice: These drawings show suggested piping configuration and valving. Check with local codes and ordinances for specific requirements.

Heater Connection Pipe Sizing and Heat Exchanger Configuration		
Heater Model	Pipe size NPS	Configurations
Spectrum 100-250	1 1/2"	Four Pass
Spectrum 300-400	1 1/2"	Two Pass
8900 420-1900	2 1/2"	Two Pass
8800 2000-4000	3"	Two Pass
Dominator 300-2100	2 1/2"	Two Pass
LCD 225-400	1 1/2"	Two Pass
LCD 600-2300	2 1/2"	Two Pass
Futura 500-1000	2"	Four Pass
Futura 1250-2000	2 1/2"	Four Pass

- Pump
- Valve
- Globe Valve
- Angle Valve
- Butterfly Valve
- Balance Valve
- Ball Valve
- Motorized Valve
- Solenoid Operated Valve
- Self-Operated Valve
- Pressure Reducing Valve
- Check Valve
- Pressure Relief Valve
- Flow Switch
- Thermometer
- Aquastat Union
- Pressure Switch
- Gas Pressure Regulator
- Automatic Air Vent

- Temperature & Pressure Relief Valve
- Vacuum Relief Valve
- Drain Valve (Typ.)